


Vemer S.p.A.


I - 32032 Feltre (BL) • Via Camp Lonc, 16
 Tel +39 0439 80638 • Fax +39 0439 80619
 e-mail: info@vemer.it - web site: www.vemer.it




Dimensions

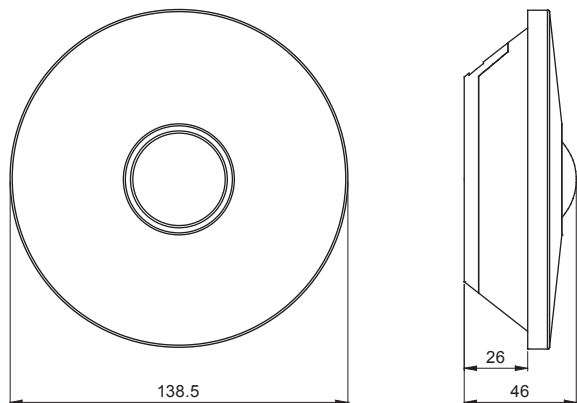

Connection diagrams


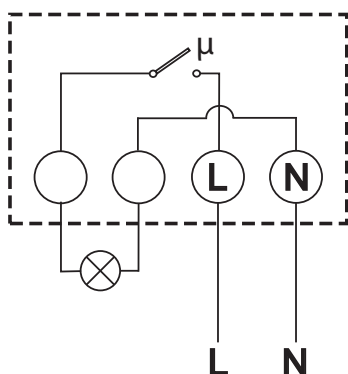


Operation

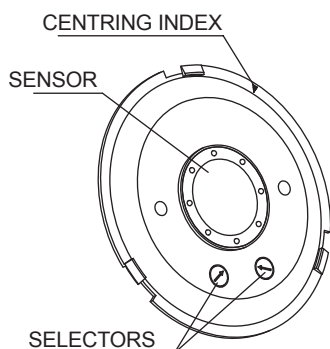

LESS SENSITIVITY

GREATER SENSITIVITY



User manual

Movement detector

Read all instructions carefully

- The **Sensor-360** proximity switch is electronic switching device containing micro-disconnection (μ) according to EN 60669-2-1. The output circuit is activated when a heat source moves in front of the device and is deactivated when no movement is intercepted, after a settable period of elapsed time.

SAFETY WARNINGS

During installation and operation of the instrument, comply with the following instructions:

- The instrument must be installed by a skilled person, in strict compliance with the connection diagrams*
- Do not power on or connect the instrument if any part of it is damaged*
- In the building where the instrument is to be installed, there must be a switch and a device for protection from overloads*
- Before touching the connector terminals make sure that the wires to be connected or already connected to the instrument are not live.*

Code	Model	Description
VP403000	Sensor-360	Movement detector 360°

TECHNICAL CHARACTERISTICS

- Power supply: 230V AC 50Hz
- Breaking capacity: 10A 250V AC (resistive load)
- Maximum recommended loads:
 - Incandescent light bulbs: 1000W
 - Non-compensated fluorescent: 500W
 - Compensated fluorescent: 250W
 - Halogen (230V AC): 1000W
 - Low consumption bulbs: 200W
- Consumption: < 2W
- Range of brightness: 3-300-∞ lux
- Time range: from 3 seconds to 10 minutes (approximate)
- Detection angle: 360°
- Maximum detection height: 5 m
- Operating temperature: -20 °C ÷ +40 °C
- Protection degree: IP20
- Insulation: class II

INSTALLATION

- The device must be installed far from inductive loads (motors, transformers, telephone antennas, transformer plants, industrial machinery, etc.) as especially strong magnetic fields may alter operation. The device must also be protected from rain and sunlight. It must not be placed near lights, near devices that are subject to temperature changes (heating, air conditioning). It must be located far from highly reflective surfaces.
- The detection area directly depends on the installation height. In particular, an installation at 2.5 meters height, permits to detection a field of 3.5 meters ray.
- The sensibility is instead influenced by the environment temperature (the higher the temperature, the worse the sensitivity because the unit operates by detecting the movement of a heat source) and by the direction of the movement.

OPERATION

- To install the instrument, remove the cover and set the selectors.
- To set the detection field:
 - rotate the “lux” selector to the “●” position and the “time” selector to the “●” position;
 - check coverage by moving within the detection field limits.
 The device permits to limit the field of the detection area. To exclude one or more sectors, applied a piece of insulating tape on the relative part of the sensor.
- The Sensor-360 proximity switch can be adjusted to that it only operates when the lighting conditions are below the selected level. By turning the “lux” selector to the “●” position, it will react under any luminosity conditions. By turning it to the “●” position, it will only react under low luminosity conditions.
- The “time” selector permits to set the switch-on delay. It's possible to choice from 3 seconds “●” to 10 minutes “●”.

REFERENCE STANDARDS

Conformity to the EU directives:
 2006/95/EC (low voltage)
 2004/108/CE (EMC)
 is declared with reference to harmonized standard:
 EN 60669-2-1